


5.2.2 120/240 V, 1 Phase, 3 Wire Service – 400 A Meter Socket Assembly with an Integral CT

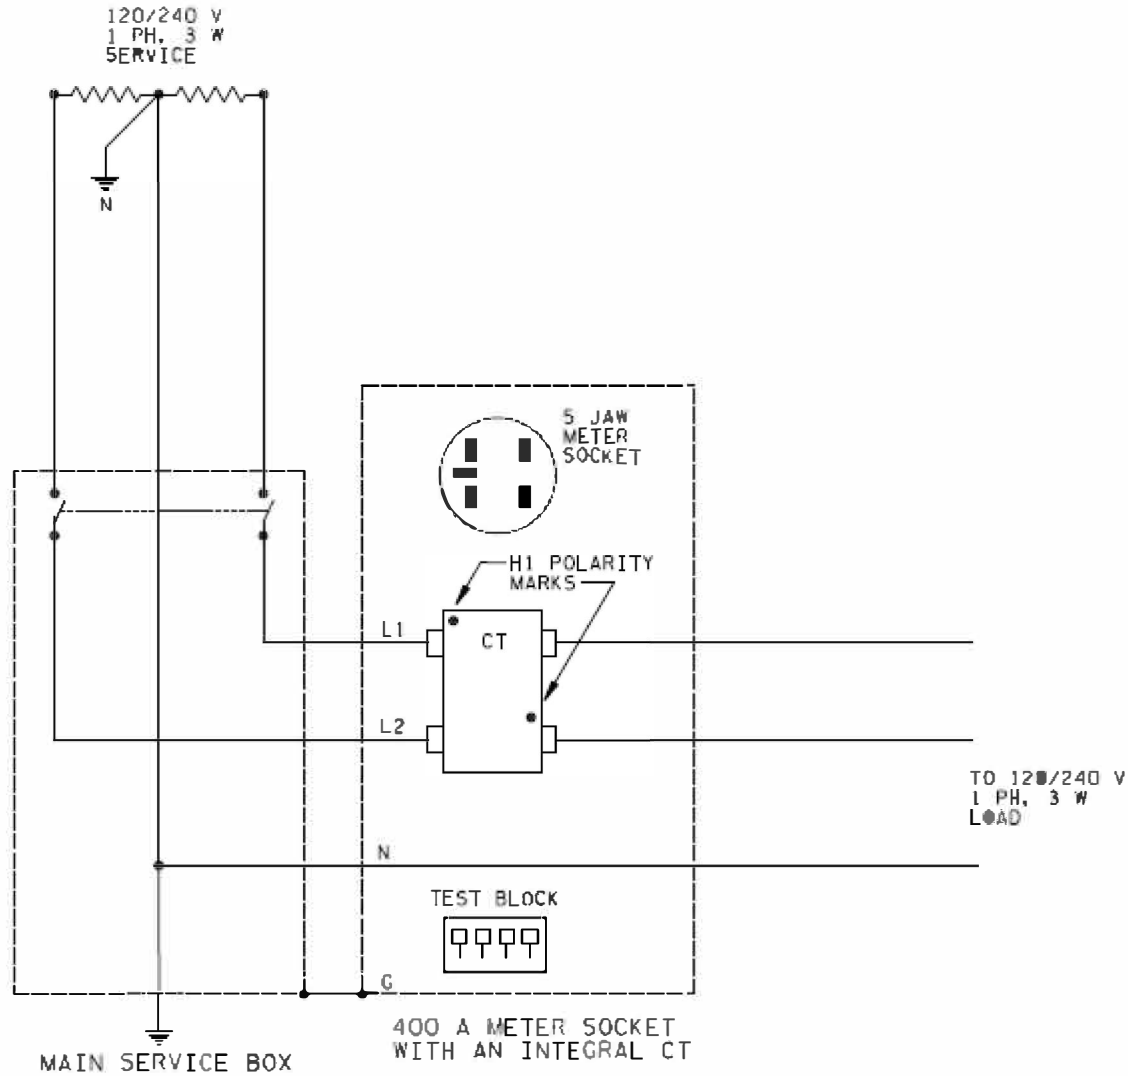

Notes:

1. See section [5.5](#) and [5.3.2.1](#).
2. Approved sockets, CT4-BC-INK or JS4B-STW and JS4B-4STW

New approved meter socket assembly with integral CT c/w Circuit Breaker are;

- Hydrel CT4-WS0H-BC
- Hydrel CT4-WS-BC

The above shall be per BC Hydro Distribution Standards Equipment Advisory dated January 30, 2015. Inquire from Local BCH design regarding this advisory.